

ISSUE/REVISION:


10/01/15	ADDENDUM 1
10/13/15	ADDENDUM 2
10/21/15	ADDENDUM 3
11/06/15	ADDENDUM 4

GENERAL NOTES (THIS SHEET)

- REFER TO ARCHITECTURAL PLANS FOR EXACT FIXTURE LOCATIONS IN PUBLIC, RESTAURANT, RETAIL AND GUEST AREAS. VERIFY WALL MOUNTING HEIGHTS, PENDANT LENGTHS AND COVE INSTALLATION DETAILS PRIOR TO ROUGH IN.
- ALL EXIT SIGNS AND EGRESS LIGHTING FIXTURES TO BE CONNECTED TO LIFE SAFETY EMERGENCY CIRCUITS.
- EGRESS LIGHTING IN PUBLIC AREAS WITH LIGHTING CONTROLS SHALL BE CONNECTED VIA UL924 POWER TRANSFER RELAY DEVICES TO ILLUMINATE AT 100% OUTPUT WHEN NORMAL POWER IS LOST.
- COORDINATE LUMINAIRE LOCATIONS WITH OTHER TRADES, SUCH AS PIPING AND DUCTWORK TO AVOID CONFLICTS.
- LUMINAIRES THAT MOUNT DIRECTLY TO UNDERSIDE OF CONCRETE FLOOR SLABS OR IN CONCRETE WALLS SHALL HAVE JUNCTION BOXES IMBEDDED FLUSH IN PT SLAB OR WALL WITH CONDUIT CONCEALED IN SLAB OR WALL. COORDINATE EXACT LOCATIONS AND CONDUIT ROUTING REQUIREMENTS WITH CONCRETE FORMING, RE-BAR AND POST TENSION TENDON ROUTING.
- MANY AREAS WILL HAVE EXPOSED STRUCTURE, PIPING AND DUCTWORK. CONTRACTOR SHALL CONCEAL CONDUIT RUNS IN WALLS AND FLOOR SLABS WHERE POSSIBLE, COORDINATING WITH OTHER TRADES. SURFACE MOUNTED CONDUIT SHALL BE MINIMIZED AS MUCH AS POSSIBLE. WHERE SURFACE CONDUIT IS REQUIRED IT SHALL BE CAREFULLY ROUTED IN COORDINATION WITH OTHER TRADES. ELECTRICAL CONDUIT SHALL BE RUN IN NEAT GROUPINGS; PARALLEL OR PERPENDICULAR TO ARCHITECTURAL FEATURES AND AS HIGH TO THE CEILING AS POSSIBLE. THERE SHALL BE NO EXPOSED LINE VOLTAGE OR LOW VOLTAGE WIRING.
- REFER TO SHEET E402 FOR ADDITIONAL INFORMATION ON LIGHTING CONTROL.

KEY NOTES (THIS SHEET)

- ALL TYPE H4V LUMINAIRES LOCATED IN THE COURTYARD ARE CONNECTED TO CIRCUIT H2G-50 AND DS.2.
- ALL TYPE H1V LUMINAIRES LOCATED AT THE MAIN ENTRANCE / CANOPY AREA ARE CONNECTED TO CIRCUIT H2G-52 AND DS.3.
- PROVIDE 120V CONNECTION TO OVERHEAD GARAGE DOOR. VERIFY EXACT LOCATION AND REQUIREMENTS PRIOR TO ROUGH-IN. PROVIDE RELAY MODULE AND INTERCONNECT WITH FIRE ALARM SYSTEM TO CLOSE UPON HOTEL FIRE ALARM SIGNAL.
- ALL TYPE L6V LUMINAIRES LOCATED ON THE COURTYARD BRIDGE SHALL BE CONNECTED TO CIRCUIT HEM-42 AND DS.1.
- MOUNT LUMINAIRE TYPE HW2E AT COURTYARD LEVEL ELEVATION ON GARAGE OVERHANG. VERIFY EXACT LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN.

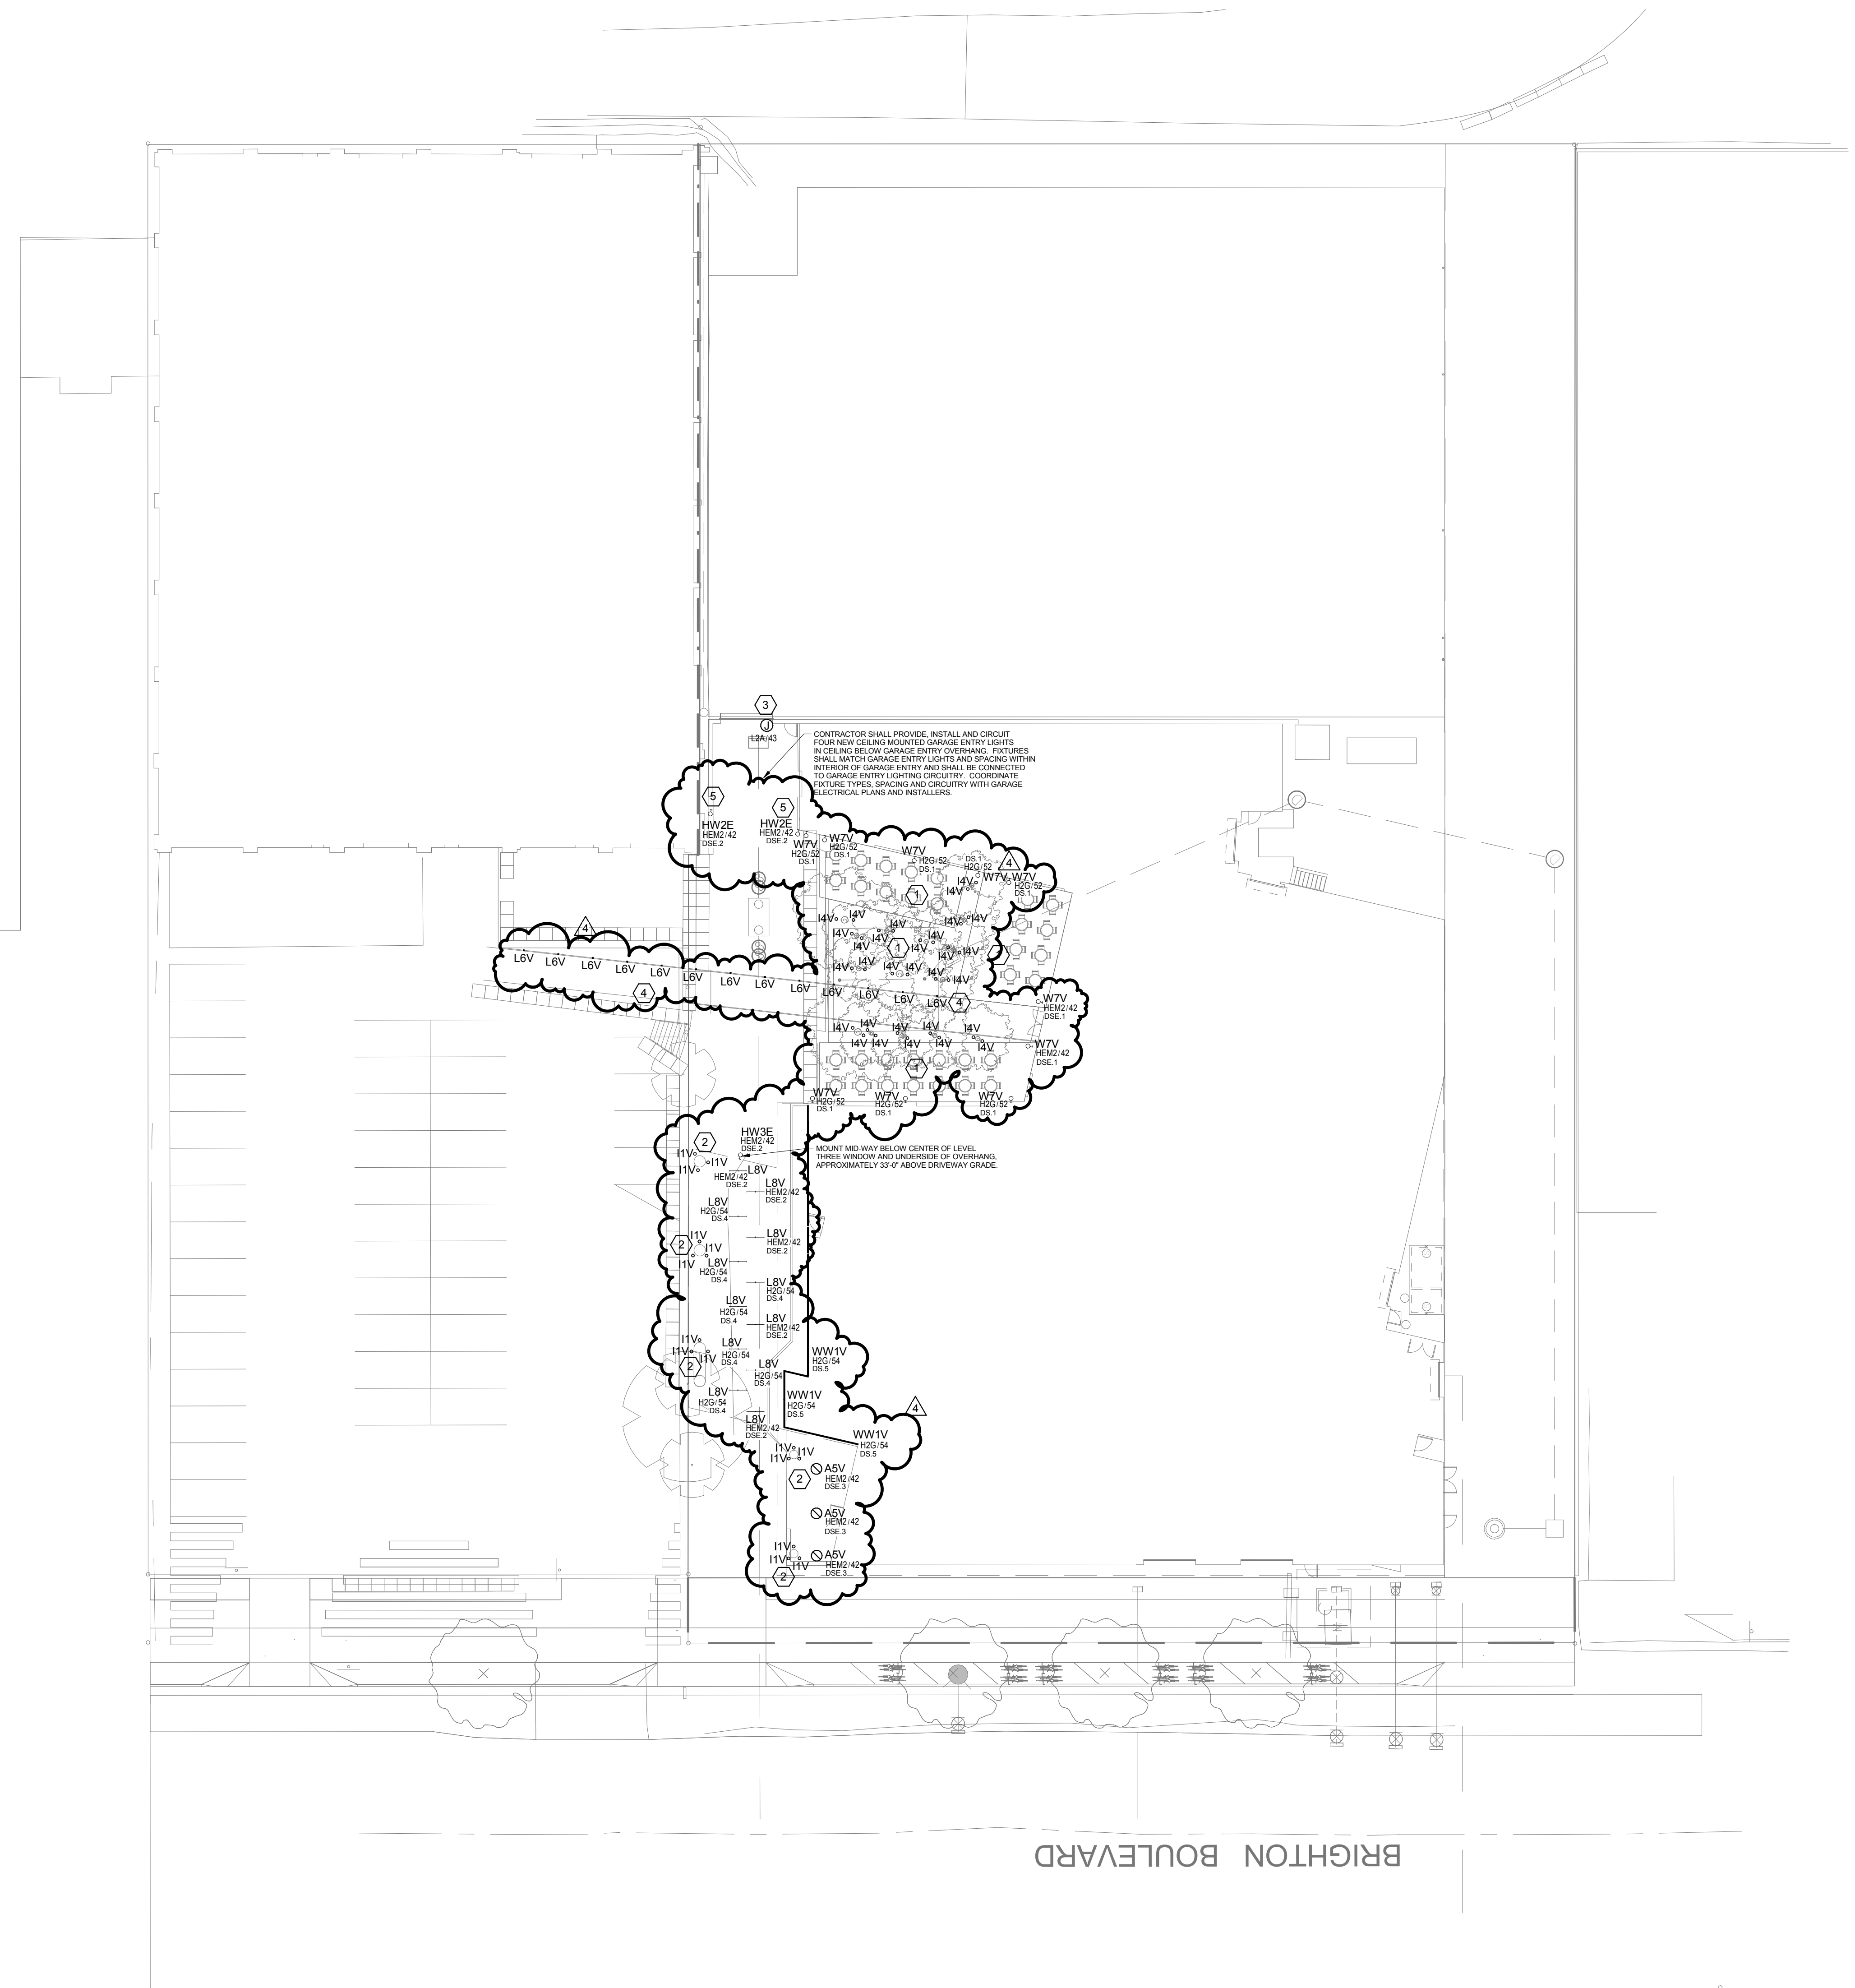

**1 S - SITE ELECTRICAL PLAN**  
SCALE: 1" = 20'-0"